


1F., No.40, Juren Ln., Sec. 2, Sanmin Rd., Banciao Dist., New Taipei City

22069, Taiwan (R.O.C.)

Phone: 886-2-2957 5580 Fax: 886-2-2957 7473

#### 1600W Battery Charger Power supply> RPB-1600



























#### ■ Features

- Charger for lead-acid batteries (Gel, flooded and AGM) and Li-ion batteries (lithium iron and lithium manganese)
- · Built-in default 3 stage charging curves and programmable curve
- Built-in I<sup>2</sup>C interface, PMBus protocol (Optional CANBus protocol)
- Universal AC input / Full range (Withstand 300VAC surge input for 5 seconds)
- · Built-in active PFC function
- · Forced air cooling by built-in DC fan
- · Output voltage and current programmable
- · Built-in OR-ing FET
- Active current sharing up to 4800W(2+1)
- Protections: Battery under voltage / Battery no connection
   / Short circuit / Over voltage / Over temperature
- · Optional conformal coating
- · 5 years warranty


## Applications

- Large scale DC UPS or emergency backup system
- · Marine battery charger module
- · Electric scooter or vehicle charger station
- · Wastewater treatment system
- · Electrolysis system

#### Description

RPB-1600 is a 1.6KW single output AC/DC charger with a high power density up to 25W/inch³. Three embedded charging curves, specifically for the lead-acid batteries, are built into each model. Thanks to the communication protocol, PMBus, and CANBus one spare curve can be further accommodated to fit other types of batteries such as the li-ion batteries. Each model is cooled by the thermostatically controlled fan. Moreover, RPB-1600 provides various protection mechanisms, offering the best safety for diversified types of applications.

#### Model Encoding



Type	Communication Protocol	Note
Blank	PMBus protocol	In Stock
CAN	CANBus protocol	By request



1F., No.40, Juren Ln., Sec. 2, Sanmin Rd., Banciao Dist., New Taipei City 22069, Taiwan (R.O.C.)
Phone: 886-2-2957 5580 Fax: 886-2-2957 7473

## 1600W Battery Charger Power supply> RPB-1600

### **SPECIFICATION**

MODEL		RPB-1600-12	RPB-1600-24	RPB-1600-48				
	BOOST CHARGE VOLTAGE(Vboost)(default)	14.4V	28.8V	57.6V				
	FLOAT CHARGE VOLTAGE(Vfloat)(default)	13.8V	27.6V	55.2V				
	CONSTANT CURRENT(CC)(default)	100A	55A	27.5A				
	VOLTAGE AD L DANGE	By built-in potentiometer, SVR						
OUTPUT	VOLTAGE ADJ. RANGE Note 5	11.5 ~ 15V	23.5 ~ 30V	47.5 ~ 58.8V				
	RECOMMENDED BATTERY CAPACITY(AMP HOURS) Note.3	330 ~ 1000Ah	180 ~ 550Ah	90 ~ 270Ah				
	LEAKAGE CURRENT FROM BATTERY (Typ.) Note.8	<45mA						
		90 ~ 264VAC 127 ~ 370VDC						
8	FREQUENCY RANGE	47 ~ 63Hz						
	POWER FACTOR (Typ.)	47 ~ 63 HZ  0.97/230VAC at full load						
	EFFICIENCY (Typ.)	91%	92.5%	93.5%				
INPUT	AC CURRENT (Typ.) Note.4		15A/115VAC 8.5A/230VAC	30.370				
9	INRUSH CURRENT (Typ.)	COLD START 35A/230VAC	10/11/04/0 0.0/12004/0					
	LEAKAGE CURRENT	<2mA / 240VAC						
	LLARAGE CORRENT	15.75 ~ 18.75V	24.5 27.57	62 751/				
	OVER VOLTAGE		31.5 ~ 37.5V	63 ~ 75V				
PROTECTION		Protection type : Shut down o/p voltage, re-						
	OVER TEMPERATURE	Shut down o/p voltage, recovers automatically after temperature goes down						
8	AUXILIARY POWER	5V @ 0.3A, 12V @ 0.8A						
	REMOTE ON-OFF CONTROL	By electrical signal or dry contact Power ON:short Power OFF:open. Please refer to Function Manual						
FUNCTION	OUTPUT VOLTAGE PROGRAMMABLE(PV) Note 5	Adjustment of output voltage is allowable to 75 ~ 125% of nominal output voltage  Please refer to the Function Manual.						
	OUTPUT CURRENT PROGRAMMABLE(PC) Note 5	Adjustment of output current is allowable to 20 ~ 100% of rated current Please refer to the Function Manual.						
8	TEMPERATURE COMPENSATION	-3mV / °C / cell / (12V = 6 cells ; 24V = 12 cells ; 48V = 24 cells)						
	ALARM SIGNAL	Isolated signal output for T-alarm and DC OK						
	WORKING TEMP.	-30 ~ +70°C (Refer to "Derating Curve")						
	WORKING HUMIDITY	20 ~ 90% RH non-condensing						
ENVIRONMENT	STORAGE TEMP., HUMIDITY	-40 ~ +85°C, 10 ~ 95% RH non-condensing						
	TEMP. COEFFICIENT	±0.03%/°C (0~50°C)						
	VIBRATION	10 ~ 500Hz, 2G 10min./1cycle, 60min. each along X, Y, Z axes						
	SAFETY STANDARDS	UL62368-1, TUV EN62368-1, EAC TP TC 004 approved						
SAFETY &	WITHSTAND VOLTAGE	I/P-O/P:3KVAC I/P-FG:2KVAC O/P-FG:1.5KVAC						
EMC	ISOLATION RESISTANCE	I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25°C / 70% RH						
(Note 6)	EMC EMISSION	Compliance to EN55032 (CISPR32) Conduction Class B, Radiation Class A; EN61000-3-2,-3, EAC TP TC 020						
	EMC IMMUNITY	Compliance to EN61000-4-2,3,4,5,6,8,11, EAC TP TC 020						
	MTBF	154K hrs min. Telcordia SR-332 (Bellcon	re); 100.3K hrs min. MIL-HDBK-217F	(25°℃)				
OTHERS	DIMENSION	300*85*41mm (L*W*H)						
	PACKING	1.8Kg;6pcs/11.8Kg/1.3CUFT						
NOTE	<ol> <li>Modification for charger specification may be required for different battery specification.</li> <li>All parameters NOT specially mentioned are measured at 230VAC input, rated load and 25°C of ambient temperature.</li> <li>This is MEAN WELL's suggested range. Please consult your battery manufacturer for their suggestions about maximum charging current limitation.</li> <li>Derating may be needed under low input voltages. Please check the derating curve for more details.</li> <li>PV/PC functions when users are not operating on PMBus/CANBus. SVR functions when users are neither operating on PMBus/CANBus nor using PV/fe.</li> <li>The charger is considered a component which will be installed into a final equipment. All the EMC tests are been executed by mounting the unit on a 720mm*360mm metal plate with 1mm of thickness. The final equipment must be re-confirmed that it still meets EMC directives. For guidance on how perform these EMC tests, please refer to "EMI testing of component power supplies."</li> <li>The ambient temperature derating of 3.5°C/1000m with fanless models and of 5°C/1000m with fan models for operating altitude higher than 2000m(6500 8. When charging lead acid battery or battery without BMS, use breaker to disconnect charger and battery after fully charged.</li> </ol>							




1F., No.40, Juren Ln., Sec. 2, Sanmin Rd., Banciao Dist., New Taipei City

22069, Taiwan (R.O.C.)

Phone: 886-2-2957 5580 Fax: 886-2-2957 7473

### 1600W Battery Charger Power supply> RPB-1600

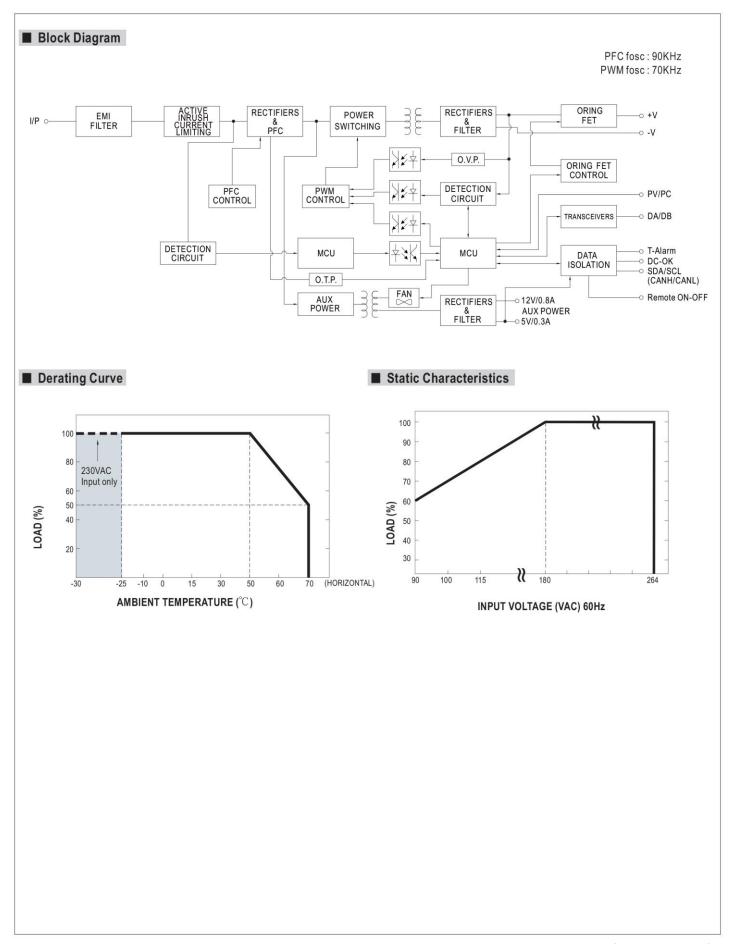



1F., No.40, Juren Ln., Sec. 2, Sanmin Rd., Banciao Dist., New Taipei City

22069, Taiwan (R.O.C.)

Phone: 886-2-2957 5580 Fax: 886-2-2957 7473


#### 1600W Battery Charger Power supply> RPB-1600

#### **■** Function Manual

#### 1.PMBus Communication Interface

#### 2. Charging Curve

- X To disable/ enable the charging curve, change to a 2 stage curve, a different curve frequently used for certain types of batteries in the industry, switch to PMBus, CANBus, PV/PC or SVR control instead and so on, please refer to the Installation Manual.

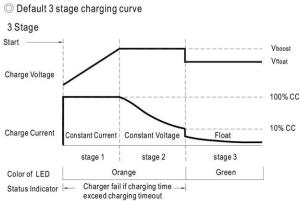

### Embedded 3 stage charging curve


MODEL	Description	Vboost	Vfloat	CC (default)
1011	Default, programmable	14.4	13.8	
	Pre-defined, gel battery	14	13.6	1004
12V	Pre-defined, flooded battery	14.2	13.4	100A
	Pre-defined, AGM battery	14.5	13.5	
24V	Default, programmable	28.8	27.6	
	Pre-defined, gel battery	28	27.2	] <sub>55A</sub>
	Pre-defined, flooded battery	28.4	26.8	] 55A
	Pre-defined, AGM battery	29	27	
48V	Default, programmable	57.6	55.2	
	Pre-defined, gel battery	56	54.4	27.5A
	Pre-defined, flooded battery	56.8	53.6	7 21.5A
	Pre-defined, AGM battery	58	54	]


## ${\bf 3. \, Front \, Panel \, LED \, Indicators \, \& \, Corresponding \, Signal \, at \, Function \, Pins}$

LED	Description
Green	Float (stage 3)
Orange	Charging (stage 1 or stage 2)
Red	Abnormal status (OTP, OLP, Fan Fail, Charging timeout.)

#### 4. Output Voltage Programming (or, PV / remote voltage programming / remote adjust / margin programming / dynamic voltage trim)

💥 In addition to the adjustment via the built-in potentiometer, the output voltage can be trimmed by applying EXTERNAL VOLTAGE.

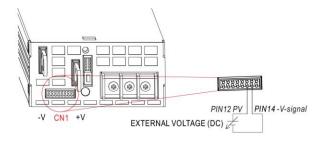

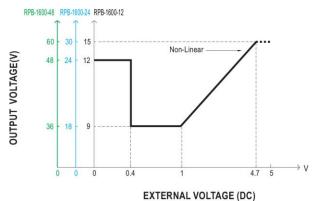

Suitable for lead-acid batteries (flooded, Gel and AGM) and Li-ion batteries (lithium iron and lithium manganese).



1F., No.40, Juren Ln., Sec. 2, Sanmin Rd., Banciao Dist., New Taipei City


22069, Taiwan (R.O.C.)


Phone: 886-2-2957 5580 Fax: 886-2-2957 7473

#### 1600W Battery Charger Power supply> RPB-1600

#### 5. Output Current Programming (or, PC / remote current programming / dynamic current trim)


※ The output current can be trimmed to 20~100% of the rated current by applying EXTERNAL VOLTAGE.

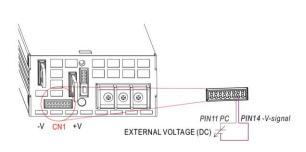




#### 6. Remote ON-OFF Control

The power supply can be turned ON/OFF individually or along with other units in parallel by using the "Remote ON-OFF" function.




Between Remote ON-OFF and +5V-AUX	Power Supply Status
Switch Short	ON
Switch Open	OFF

### 7. Temperature Compensation



- To exploit the temperature compensation function, please attach the temperature sensor, NTC, which is enclosed with the charger, to the battery or the battery's vicinity.
- The charger is able to work normally without the NTC.




When multiple chargers are connected in parallel, please configure with the NTC as exhibited in the diagram.

If the temperature compensation is not required, RTH+ (PIN15) and RTH- (PIN16) from each unit still need to be connected.

#### 8. Alarm Signal Output

※ There are 2 alarm signals, DC OK and T-ALARM, in TTL signal form, on CN1. These signals are isolated from output. The maximum sink current is 10mA.

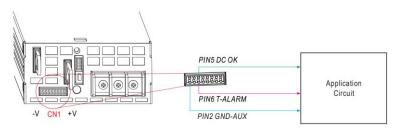



1F., No.40, Juren Ln., Sec. 2, Sanmin Rd., Banciao Dist., New Taipei City

22069, Taiwan (R.O.C.)

Phone: 886-2-2957 5580 Fax: 886-2-2957 7473

#### 1600W Battery Charger Power supply> RPB-1600


#### 9. Current Sharing


RPB-1600 has the built-in active current sharing function and can be connected in parallel, up to 3 units, to provide higher output power as exhibited below:

- X The power supplies should be paralleled using short and large diameter wiring and then connected to the load.
- X Difference of output voltages among parallel units should be less than 0.2V.
- % The total output current must not exceed the value determined by the following equation: Maximum output current at parallel operation=(Rated current per unit) $\times$ (Number of unit) $\times$ 0.9
- ※ CN500/SW1 Function pin connection

Parallel	PSU1		PSU2		PSU3	
	CN500	SW1	CN500	SW1	CN500	SW1
1 unit	Х	ON	_	=	=	_
2 unit	V	ON	V	ON	_	_
3 unit	V	ON	V	OFF	V	ON

(V: CN500 connected; X: CN500 not connected.)

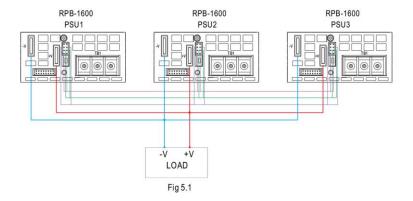

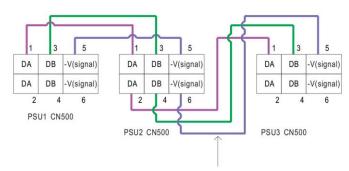

If the lines of CN500 are too long, they should be twisted in pairs to avoid the noise.

O DA,DB and -V(signal) are connected mutually in parallel.




1F., No.40, Juren Ln., Sec. 2, Sanmin Rd., Banciao Dist., New Taipei City

22069, Taiwan (R.O.C.)

Phone: 886-2-2957 5580 Fax: 886-2-2957 7473

#### 1600W Battery Charger Power supply> RPB-1600

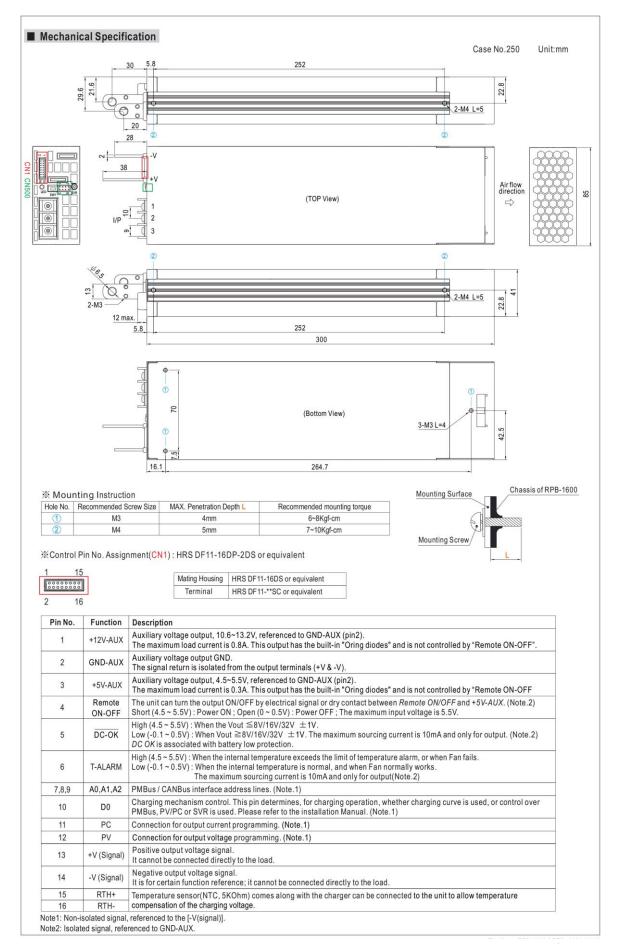



1F., No.40, Juren Ln., Sec. 2, Sanmin Rd., Banciao Dist., New Taipei City

22069, Taiwan (R.O.C.)

Phone: 886-2-2957 5580 Fax: 886-2-2957 7473

### 1600W Battery Charger Power supply> RPB-1600

**XAC Input Terminal Pin No. Assignment** 

Pin No.	Assignment	Diagram	Maximum mounting torque		
1	FG ±				
2	AC/N		8Kgf-cm		
3	AC/L				

※Control Pin No. Assignment(CN500): HRS DF11-8DP-2DS or equivalent

1	7
0 0	000
2	8

Mating Housing	HRS DF11-8DS or equivalent
Terminal	HRS DF11-**SC or equivalent

Pin No.	Function	Description
1,2 DA Differential digital signal for parallel control. (Note.1)		Differential digital signal for parallel control. (Note.1)
3,4	DB	Differential digital signal for parallel control. (Note.1)
5,6	-V (Signal)	Negative output voltage signal. It is for certain function reference; it cannot be connected directly to the load.
7	SDA	For PMBus model: Serial Data used in the PMBus interface. (Note.2)
,	CANH	For CANBus model: Data line used in CANBus interface. (Note.2)
0	SCL	For PMBus model: Serial Clock used in the PMBus interface. (Note.2)
8	CANL	For CANBus model: Data line used in CANBus interface. (Note.2)

Note1: Non-isolated signal, referenced to [-V(signal)]. Note2: Isolated signal, referenced to GND-AUX.

※Control Pin No. Assignment(SW1)

Pin No.	Function	Description
1,2	Terminal resistance	SW1 is the selector of terminal resistor that is designed for DA/DB signals and parallel control function.